

Remove Moisture and Particulate Contamination from Steam and Gas Turbine Lube Oils





The Hilliard Corporation is a WORLD LEADER



in oil conditioning systems and has Hilco® systems in operation world-wide.

Application:

The primary application for oil conditioning is removal of moisture contamination from steam turbine lube oils which have good water separabilty characteristics (ASTM-D1401) and are commonly found in the power generation industry. Other applications may include refineries, chemical plants, heavy industry and steel mills.

Benefits:

- Extends oil life
- Easy operation
- Protects system's
- Reduces maintenance
- Economically priced components from corrosion
- Increases bearing life



Self-Sufficient Stand-Alone Models

Features:

- System flow rates from 1 to 100 GPM [227-22710 LPH] Positive displacement oil pump with integral relief valve TEFC pump motor
- NEMA or IEC electrical enclosure / controls
- ASME code or non-code pre-filter or post filter vessel(s) ASME code or non-code coalescer/ separator vessel Coalescer vessel with or without separator element(s) Clean / dirty sampling ports
- Inlet Y or basket strainer
- Manual or automatic air vents
- Automatic and/or manual water drain utilizing RF point level or tubular magnetic level switches
- Liquid level sight gauge
- Screw or hydraulic jack cover lifter

Performance:

- Particulate removal efficiency of 99.5% @ 3
- Free and emulsified water content reduced to under 25 ppm
- Total water content to under 150 ppm based on a process stream content of 5% maximum

Options:

- Explosion-proof electrical controls
- Customer specific vessel, piping and controls features such as valve type, material, bypass loops, flow meter
- Customer specific operation features such as PLC control, motor VFD, transmitters, remote functions,
- lights, outlets, etc.
- Low-watt-density oil heaters
- Pre and/or post particulate filter(s)
- CRN or PED vessels
- Compliance, certifications and markings such as UL, CSA, CE, ATEX, GOST, etc.



Sizing a System:

Hilco® oil conditioning system should have a flow capacity of at least 1/2% of the total lube oil volume. The following chart depicts the recommended flow rate for reservoir size for each Hilco® oil conditioning system.

MODEL #	FLOW RATE	RESERVOIR CAPACITY
02CS10	10 GPM [2,270 LPH]	2,000 G [7,750 L]
02CS20	20 GPM [4,540 LPH]	4,000 G [15,140 L]
02CS30 02CS60	30 GPM [6,810 LPH] 60 GPM [13,625 LPH]	6,000 G [22,710 L] 12,000 G [45,425 L]
02CS100	100 GPM [22,710 LPH]	20,000 G [75,710 L]

Custom Designs

HILCO's Engineers will analyze your requirements and design systems according to your needs. From the smallest Single-Cartridge Vessel to the most complex Coalescer system. Our lab can evaluate customer samples and recommend performance level and features required.



Ex: Stainless and Carbon Steel heated system with Pre-filter. Explosion-Proof with purged electrical enclosure and transmitters. 2014



Ex: Portable, Carbon steel heated system with 2 Pre-filters. Explosion-Proof; rated for Group B (Hydrogen) atmosphere. 2008

Portable Models

Features:

- Flow capacities from 1 30 GPM [227 6815 LPH]
- ASME Code and non-code designs available
- Coalescer vessel with or without separator element(s)
- Ability to service the needs of multiple oil reservoirs
- Units may be on wheels, moved by forklift or mounted on a
- trailer
- Available with or without controls or with customer specific
- electrical requirements
- Integral particulate filter and coalescer filter arrangement
- liquid level sight gauge




Single or Multiple-Element Vessels

Features:

- Flow capacities to 100 GPM [22,710 LPH]
- Designed to side stream a portion of existing lube oil system
- pump flow
- ASME Code and non-code designs available
- Coalescer vessel with or without separator element(s)
- Duplex designs with integral transfer valve available for
- uninterrupted flow during element change
- Liquid level sight gauge
- Auto drain optional equipment



Typical System Performance

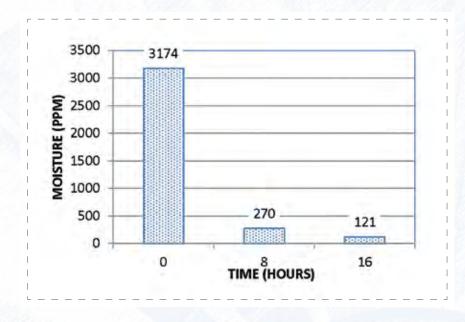

This chart depicts the moisture content of a 2,000-gallon steam turbine reservoir with a 10-GPM Hilco® oil conditioner installed.



This photo shows before Condition and result of ISO VG32 turbine lube oil, Influent Stream and Effluent Stream.

Reference Materials

- For Liquid Fuel Coalescers see brochure FPLF
- For Vacuum Dehydrators see brochure ORB-5
- For Vent Mist Eliminators see brochure VME-1





The Hilliard Corporation

100 West Fourth Street Elmira, New York 14902-1504 USA PHONE: 607.733.7121

FAX: 607.737.1108 hilliardcorp.com hilliard@hilliardcorp.com



